
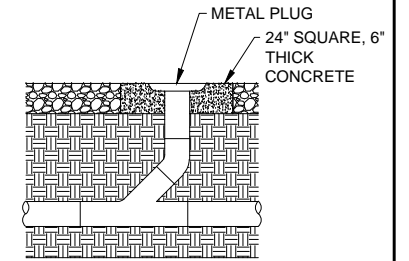





RICKWALES - 8/24/2022 - 07:27 - C:\USERS\RICKWALES\ONEDRIVE - POWER CENTRIC SOLUTIONS\SHARED DOCUMENTS\FRANKFORT KY 1125\1125-03 CAPITAL PLAZA SUBSTATION\WORK PRODUCTS\CAD\1125-03-507.DWG - LAYOUT1

NOTES:

1. ALL CONDUIT TO BE 6 INCH PVC, SCHEDULE 80 BELOW GRADE.
2. ALL CONDUIT TO MAINTAIN 1% MINIMUM SLOPE.
3. EXTEND CONTAINMENT PIT OUTFALL PIPE TO DAYLIGHT.
4. INSTALL CONCRETE APRON, BACKWATER VALVE, AND RODENT GUARD ON END OF OUTFALL PIPE.



CLEANOUT DETAIL

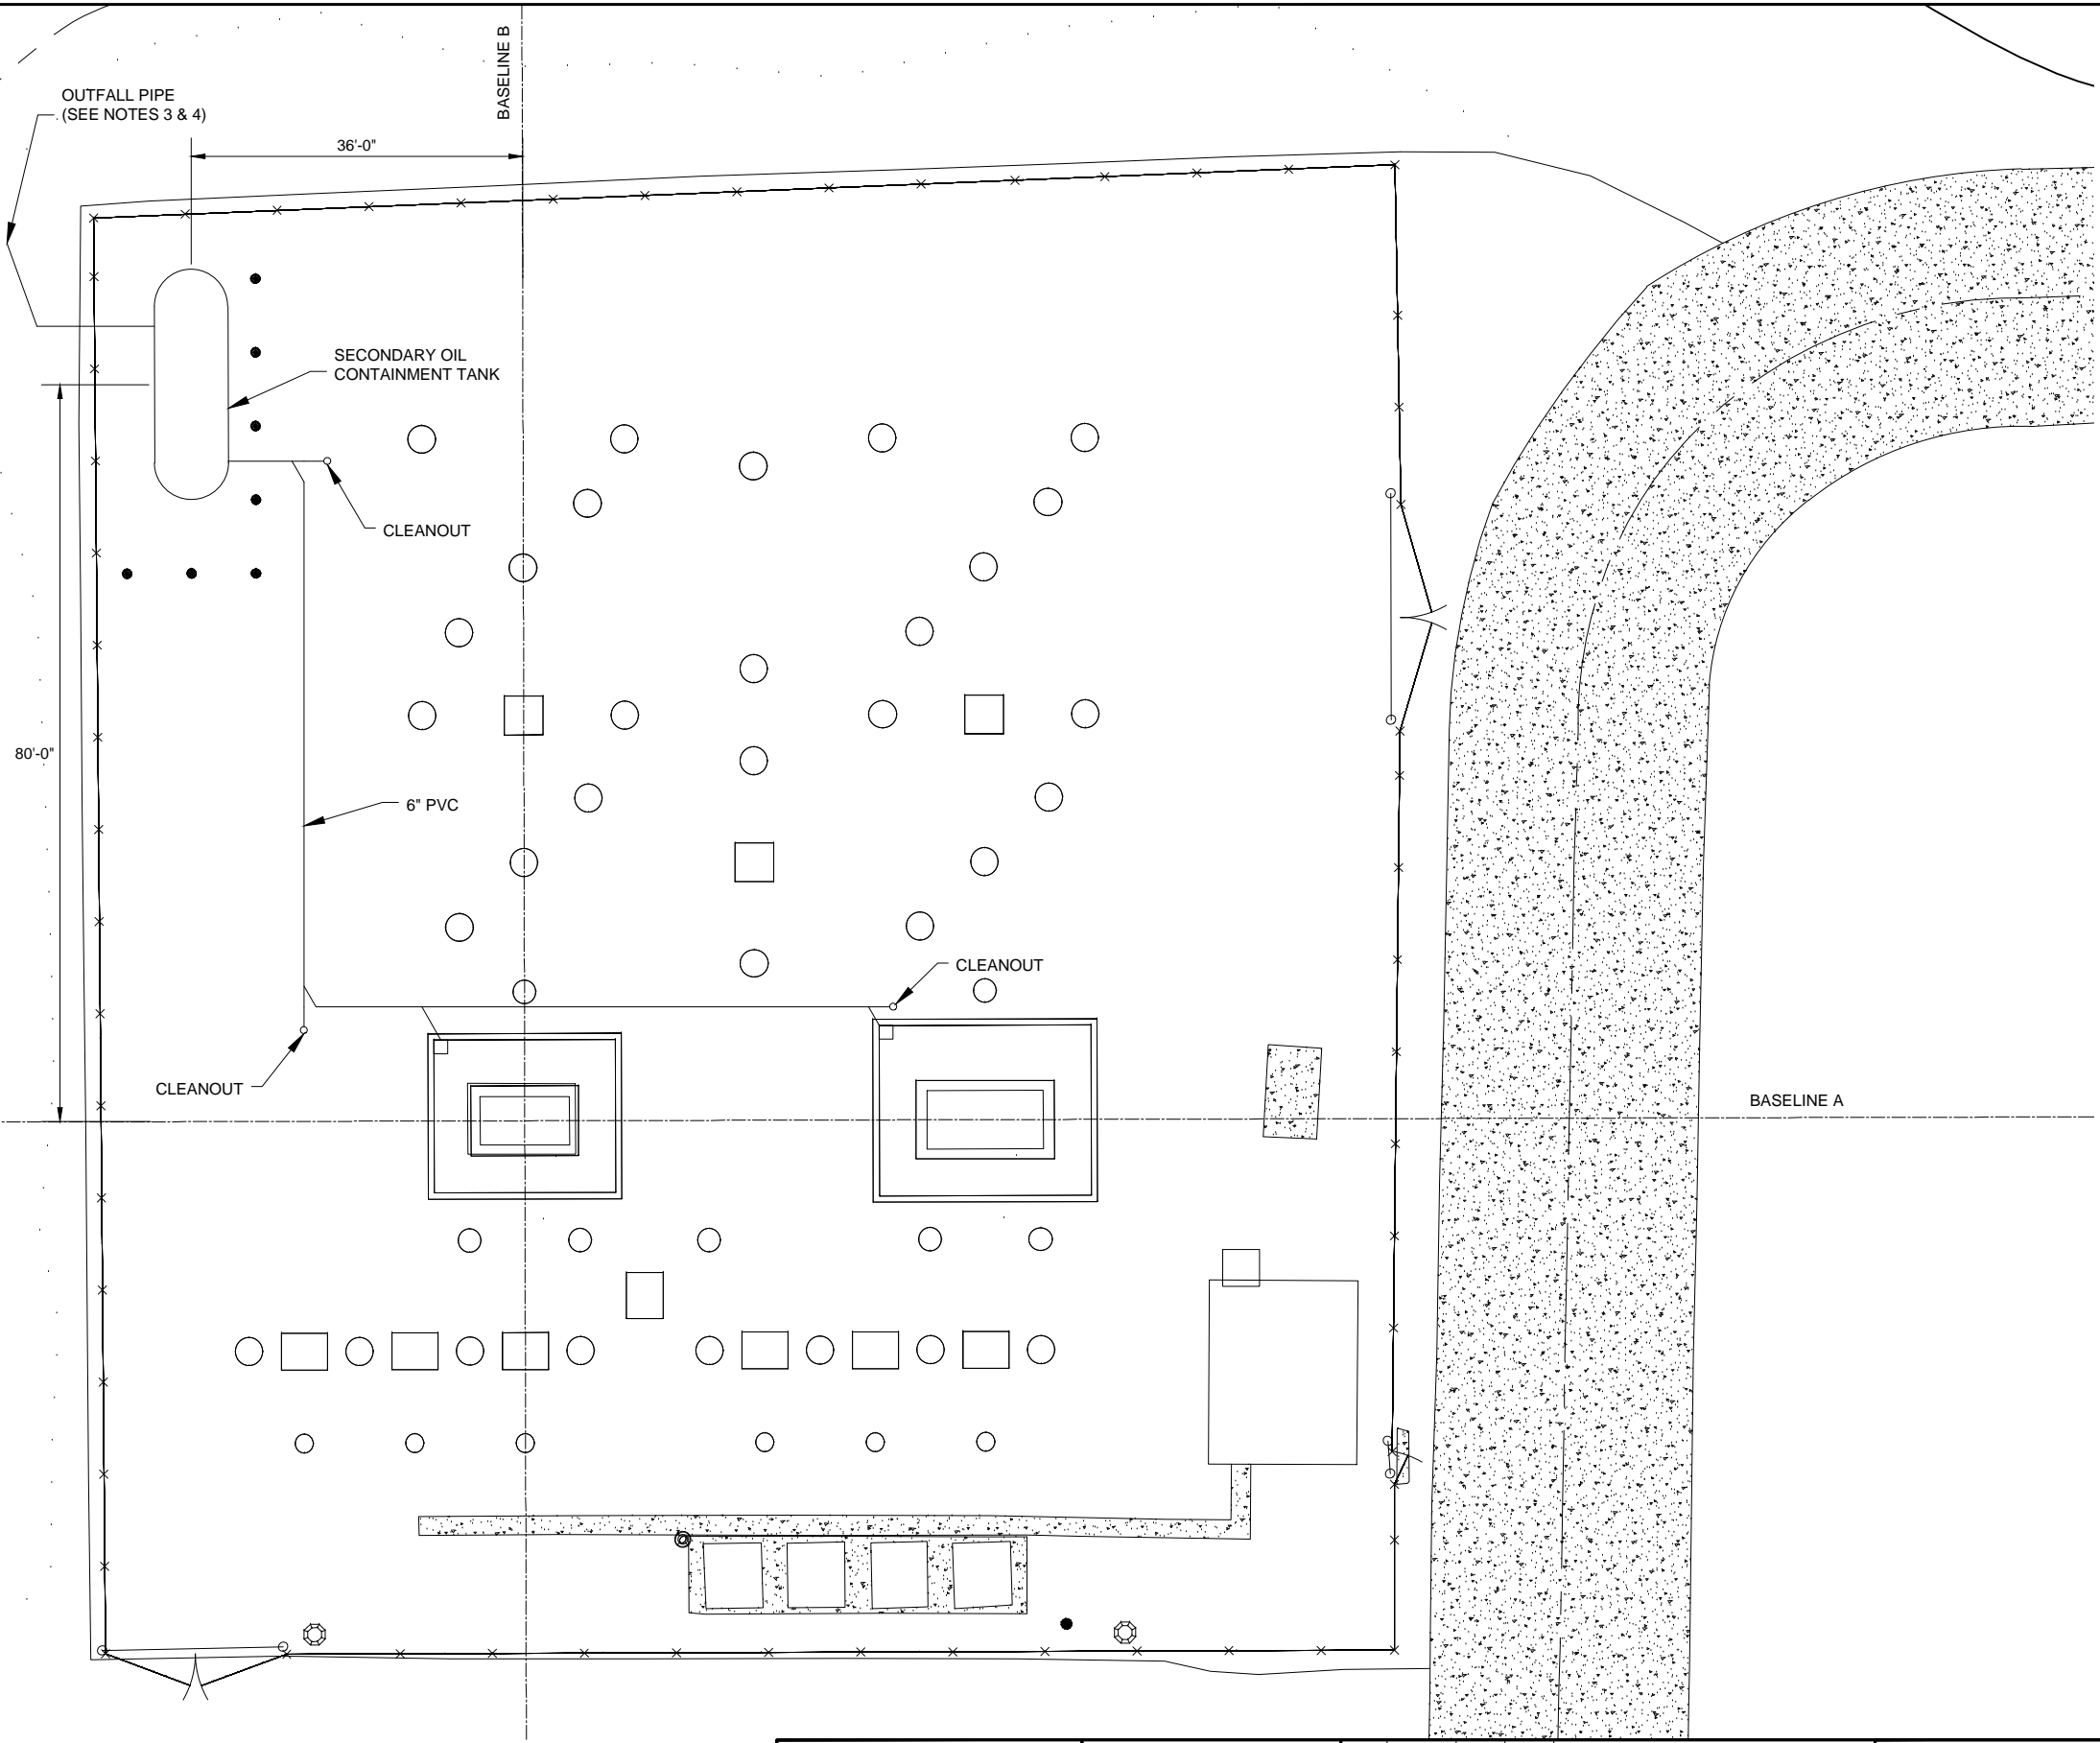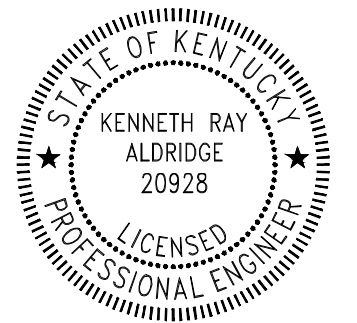

ISSUED FOR CONSTRUCTION						FRANKFORT PLANT BOARD FRANKFORT, KY CAPITAL PLAZA SUBSTATION	DRAW: ADW CHK'D: KRA APP'D: KRA SCALE: 1" = 10' (11X17") DATE: 08.23.22 DRAWING NUMBER: 1125-03-507
		0 REV	08.24.22 DATE	KRA CHK'D	KRA APP'D		ISSUED FOR CONSTRUCTION. REVISION DESCRIPTION